


LG Electronics, Home appliance & Air solution company

56, Digital-ro 10-gil, Geumcheon-gu, Seoul, Republic of Korea (153-801) www.lg.com www.lgeaircon.com





LG HVAC SOLUTION AIR COOLED INVERTER SCROLL CHILLER

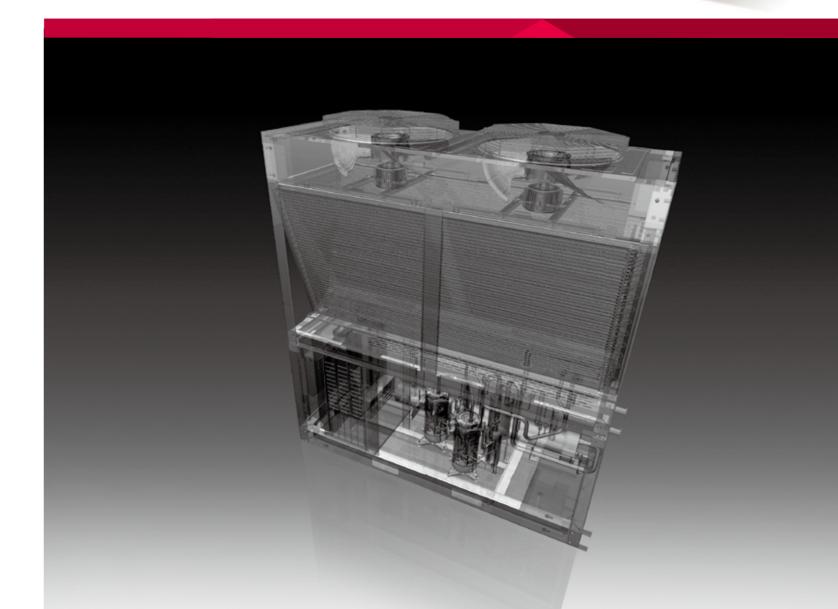

For continual product development, LG reserves the right to change specifications or designs without notice. © 2020 LG Electronics. Printed in Korea. Apr. 2020

Distributed by



Nomenclature

AC = R410A / Chiller




Evaporator :

T = DX type(Shell & Tube)

Line up Introduction

Line up

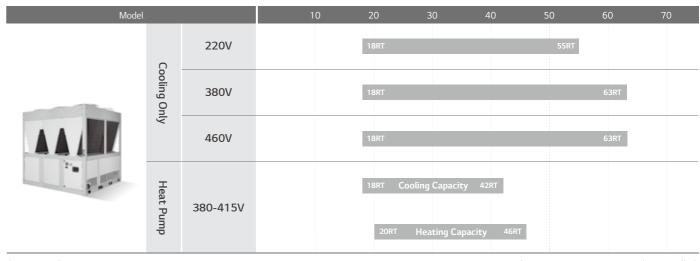

* @T1 Condition

LG Air cooled water chillers are complete, self-contained automatic refrigerating units that include the latest in engineering components arranged to provide a compact and efficient unit. Each unit is completely assembled; factory wired, evacuated, charged, tested and comes complete and ready for installation. Each unit consists of multiple air-cooled condensers with integral subcooler sections, two or more accessible hermetically scroll compressors, high efficiency evaporator, and electronic expansion valves.

- High-performance compressor manufactured by LG to ensure that the chiller is economical and durable with low vibration and low noise.
- Highly integrated motherboard is adopted and hence the function is strong and reliable.
- Advanced control algorithm is adopted to control chiller in advance and hence avoid frequent stoppage protection of chiller.
- We have set complete safety protection function in order to make chiller safely and reliably run.
- The linkage control and remote monitoring function of peripheral equipment ensure that the chiller can run safely and the operation and monitoring are convenient.
- The selection of excellent raw materials and fittings is the key to guaranteeing chiller quality.

Excellent reliability and powerful operation

The cutting-edge design of Air-cooled scroll chiller accomplishes high performance and reliability for industrial and commercial

AC A H 060 L E T B

Compressor type :

R = Scroll(Low pressure type) H = Scroll(High pressure type) Power specification :

V = 208-230V / 3Ø

L = 380-415V / 3Ø H = 460V / 3Ø

	Capacity(RT) : 060 = 60 RT		
Cooled type :	045 = 45 RT		
A = Air cooled C/O	040 = 40 RT	Product type :	
W = Water cooled C/O	033 = 33 RT	A = Module model	
H = Air cooled H/P	023 = 23 RT	B,E = Independent model	
K = Water cooled H/P	020 = 20 RT	C = Slave model	Desian Sequence

Contents

Nomenclature	02
Line up & Introduction	03
Features	04
Specification	06
Electric characteristics	12
Outline dimension	13
Foundation	18
Piping diagram	20
Wiring diagram	25
Installation of chiller	35
Guide specification	41





* Up to 5 units per 1 HMI can be controlled.



market.

LG Air-cooled scroll compressors are precisely machined from solid compound metal bar using profound cutting process. Tolerance is maintained within a few microns just like onetenth hair thickness. Robust components with highly skilled assembling process help the compressor last for a long time.

LG condenser production technology is already well-known to worldwide air conditioning manufacturing industries because of its leading technologies.

World class high efficiency

The evaporator uses internally grooved tubes having helical angle which enhanced the refrigerant side heat transfer performance. The V-shape of condenser allows the largest heat transfer surface area for the same footprint, resulting in largest heat transfer performance when the configuration is optimally designed.

The LG V-shape condenser coil was designed using numerical and experimental analysis, having optimum air flow path to



optimize heat rejection performance.

Also, the enhanced condenser fin geometry allows the optimum heat transfer performance at small air side pressure drop, and this reduces the fan-motor power consumption. The fin is precoated to prevent corrosion at normal conditions and epoxy coated fin condenser which is sustainable in harsh conditions, is also available as option.

Low noise and low vibration

The unit was designed with a compact structure and robust assembly. The condenser fan is completed with high-efficiency wing style axial fan and direct driven motor for low sound level. The unit configures compressor sound insulation box(Option), which makes LG chillers silent and stable.

Installation, start-up

- Small operating footprint fit most retrofit applications.
- Factory testing for high reliability.
- Factory-installed and tested controls help to reduce start up time and minimized extra cost.
- Display temperatures and pressure for each component spot.

Compressor specification

- Hermetically sealed DC Scroll compressor.
- Variable Speed Drive(VSD)
- The VSD optimized for part-load conditions.
- A refrigerant dispersing device is set internally to the compressor for motor cooling.

Factory testing/Unit performance testing

LG air-cooled scroll chillers are given a complete functional test at the factory. LG computer-based testing programs completely check the components including sensors, wiring, electronics and microprocessor control functions.

LG promotes factory performance tests for air-cooled chillers to show that we stand behind the products which are designed and build up.

The benefits of a performance test include verification of performance, prevention of operational problems, and assurance of a smooth start-up. Each compressor is run and tested to verify capacity and efficiency.

Structural strength analysis

Structure is designed to ensure stiffness for various disturbances by steps of structure modeling, meshing, excitation and evaluation. **Structural strength evaluation simulation**

Aerodynamic analysis

Condenser part is appropriately designed by aerodynamic analysis like inlet and outlet uniform airflow design and dead zone reduction design.

Heat circulation evaluation simulation

Refrigerant R410A

System designed with Eco-friendly refrigerant R410A which does not harm the ozone layer & protects the environment. The HCFC(R22, R123) series cannot produce any more from 2020 according to the Montreal Protocol for protection of ozone layer.

Black fin(Heat exchanger)

Heat Exchanger of outdoor unit is the core part that contributes to consistent cooling performance, yet is most vulnerable to corrosion. LG's exclusive black fin is highly corrosion resistant, designed to perform in corrosive environments such as coastal area.



Black fin(Heat exchanger)

Black coating

The black coating is heavy anti-corrosion treatment applied to industrial equipment in the ocean. This special coating protects heat exchanger from high salinity, humidity and pollution

Salt water spray test

Heat exchanger with black fin passed 3,000 hour salt water spray test, while conventional heat exchanger started to corrode after 1,000 hours.

Selection guide

The product information required in various requirements is written in detail from performance data.

If you need a product for special system application or product with the condition outside this catalogue, please get

consultation from nearby sales office or specialty store.

Selection procedure

- 1. Check usage condition
- Before selecting the model, the following usage conditions must be decided.
- Chilled water in/out temperature and outdoor temperature
- Chilled water flow amount(flow amount can be calculated if you know the freezing load and chilled water in/out temperature.)
- 2. Selecting candidate model

Required rated capability is selected through load calculation, and you can select the corresponding model by looking at specification & performance data table.

When you select the candidate model, do not select a model with less volume than the required rated capability, but select a model with the same or bigger volume.

3. Performance adjustment for fouling

The data in this technical data manual is based on chilled water fouling coefficient of 0.000018 m²⁰C/W at sea level. If altitude or fouling coefficient is different, you have to apply appropriate adjustment coefficient form the following table to calculate data for the operation condition.

	Water		Fouling coefficient						
Altitude	in/out	0.00001	8 m²₀C/W	0.00005	4 m ² ºC/W				
	temperature difference(°C)	Cooling capability	Power consumption	Cooling capability	Power consumption				
	4	0.991	0.998	0.979	0.996				
	5	1.000	1.000	0.990	0.998				
Sea level (0m)	6	1.010	1.002	1.001	1.000				
	7	1.020	1.005	1.010	1.003				
	8	1.028	1.006	1.019	1.004				
	4	0.988	1.004	0.979	1.002				
	5	0.998	1.006	0.988	1.004				
500 m	6	1.008	1.008	0.998	1.006				
	7	1.017	1.010	1.008	1.008				
	8	1.026	1.012	1.017	1.010				
	4	0.985	1.011	0.977	1.008				
	5	0.995	1.013	0.985	1.010				
1,000 m	6	1.005	1.015	0.995	1.012				
	7	1.014	1.017	1.005	1.014				
	8	1.023	1.019	1.014	1.016				
	4	0.982	1.018	0.974	1.016				
	5	0.992	1.020	0.983	1.018				
1,500 m	6	1.002	1.022	0.993	1.020				
	7	1.011	1.025	1.003	1.023				
	8	1.020	1.027	1.011	1.025				

4. Performance adjustment after adding freeze and burst prevention solution

If cooling operation is performed in Winter, or if water inside



the cycle is not removed in the resting phase, you have to add freeze and burst prevention solution to protect from freeze and burst.

Freezer characteristics change by adding freeze and burst prevention solution, so it should be adjusted.

Refer to the following table for the adjustment coefficient after adding freeze and burst prevention solution.

Antifreeze	ltom	Antifreeze % by wt						
Туре	Item	10 %	20 %	30 %	40 %	50 %		
	Cooling	0.998	0.997	0.995	0.993	0.992		
Methanol	Heating	0.995	0.990	0.985	0.979	0.974		
	Pressure Drop	1.023	1.057	1.091	1.122	1.160		
	Cooling	0.996	0.991	0.987	0.983	0.979		
Ethylene glycol	Heating	0.993	0.985	0.977	0.969	0.961		
57	Pressure Drop	1.024	1.068	1.124	1.188	1.263		
	Cooling	0.993	0.987	0.980	0.974	0.968		
Propylene glycol	Heating	0.966	0.973	0.960	0.948	0.935		
3.9001	Pressure Drop	1.040	1.098	1.174	1.273	1.405		

5. Finalizing the model

As a result of verifying product performance and power consumption considering various adjustment coefficients for the candidate models, if there is no problem, you can finalize it as the final model.

If there is a problem, review again from the candidate model selection stage.



Specification Cooling only

380V

	verter Scroll Chiller	Model	ACAH020LETB	ACAH023LETB	ACAH033LETB	ACAH040VETB		
		Woder	C/0	C/0	C/0	C/0		
	Power	Phase, Lines, V		3, 4, 38	30-415			
	Capacity	kW	65	74	114	130		
	Capacity	RT	18.5	21.0	32.4	37.0		
	Input Power	kW	21.5	28.5	36.2	43.0		
	Efficiency	W/W	3.02	2.60	3.15	3.02		
	IPLV	W/W	5.3	5.1	5.4	5.3		
	Sound Pressure	dB(A)	64	66	66	67		
	Туре	-		Inverte	r Scroll			
C	No. of Compressor	EA	2	2	4	4		
Compressor	Oil Type	-		P	/E			
	Oil charge	СС	1,400 x 2	1,400 x 2	1,400 x 4	1,400 x 4		
Definent	Туре	-		R41	10A			
Refrigrant	Amount of Charged	kg	6.5 x 2	6.5 x 2	6.5 x 4	6.5 x 4		
	Туре	-		Shell a	& Tube			
	Pressure drop	kPa	38.8	49.2	29.6	38.8		
Evaporator	Operating maximum pressure(Refrigrant / Water)	kg/cm ²	42/10					
	Water Flow Rate(Standard)	LPM	186	211	327	372		
	Inlet/Outlet diameter(Water pipe)	mm	50A/50A	50A/50A	65A/65A	65A/65A		
	Туре	-		BL	DC			
	No. of Fan	EA	2	2	4	4		
Fan motor	No. of Vanes(per fan)	EA			5			
	Air Flow Rate	CMM	246 x 2 @1,000rpm	246 x 2 @1,000rpm	246 x 4 @1,000rpm	246 x 4 @1,000rp		
	Motor power	W	900 x 2	900 x 2	900 x 4	900 x 4		
	Expansion unit	-		El	EV			
	Weight	kg	560	560	1,034	1,034		
	W	mm	765	765	1,528	1,528		
Dimension	н	mm		2,2	00			
	D	mm		2,1	54			
	Footprint	m²/RT	0.089	0.078	0.102	0.089		
Protection	High/Low Pressure	-	0					
Devices	Anti Frost	-	0					
	Remote Control	-		Мос	lbus			
	Outlet Temperature	°C		4~	20			
A	Ambient Temperature	°C		-15	~48			
Guaran	nteed Load Capacity Range	-		20 % ~	100 %			

208-230V

Inverter Scroll Chiller			ACAH020VETB	ACAH033VETB	ACAH040VETB	ACAH050VETB	ACAH060VETB
יחו	verter Scroll Chiller	Model	C/0	C/0	C/0	C/0	C/0
	Power	Phase, Lines, V			3, 3, 208-230		
	Coursi I	kW	65	114	130	171	195
	Capacity	RT	18.5	32.4	37	48.6	55.4
	Input Power	kW	21.7	36.8	43.3	55.2	65.0
	Efficiency	W/W	3.00	3.10	3.00	3.10	3.00
	IPLV	W/W	5.0	5.1	5.0	5.1	5.0
	Sound Pressure	dB(A)	64	66	67	68	69
	Туре	-			Inverter Scroll		
C	No. of Compressor	EA	2	4	4	6	6
Compressor	Oil Type	-			PVE		
	Oil charge	СС	1,400 x 2	1,400 x 4	1,400 x 4	1,400 x 6	1,400 x 6
Defricement	Туре	-			R410A		
Refrigerant	Amount of Charged	kg	6.5 x 2	6.5 x 4	6.5 x 4	6.5 x 6	6.5 x 6
	Туре	-			Shell & Tube		
	Pressure drop	kPa	38.8	29.6	38.8	29.6	38.8
Evaporator	Operating maximum pressure(Refrigerant / Water)	kg/cm ²			42/10		
	Water Flow Rate(Standard)	LPM	186	327	372	491	558
	Inlet/Outlet diameter(Water pipe)	mm	50A/50A	65A/65A	65A/65A	65A/65A	65A/65A
	Туре	-			BLDC		
	No. of Fan	EA	2	4	4	6	6
Fan motor	No. of Vanes(per fan)	EA			6		
	Air Flow Rate	СММ	246 x 2 @1,000rpm	246 x 4 @1,000rpm	246 x 4 @1,000rpm	246 x 6 @1,000rpm	246 x 6 @1,000rpm
	Motor power	W	900 x 2	900 x 4	900 x 4	900 x 6	900 x 6
	Expansion unit	-			EEV		
	Weight	kg	560	1,034	1,034	1,522	1,522
	W	mm	765	1,528	1,528	2,291	2,291
Dimension	Н	mm			2,200		
	D	mm			2,154		
	Footprint	m²/RT	0.089	0.102	0.089	0.101	0.089
Protection High/Low Pressure		-			0		
Devices					0		
	Remote Control	-			Modbus		
	Outlet Temperature	°C			4~20		
Δ	mbient Temperature	°C			-15~48		
Guaran	teed Load Capacity Range	-			20 % ~ 100 %		

1. Due to our policy of innovation some specifications may be changed without prior notification.

Due to the policy of inflowation some spectratation may be changed without provinceton.
 Capacities and Inputs are based on the following conditions
 Cooling: Outdoor air temp. 35°C, Water inlet temp. 12°C, Water Outlet temp. 7°C
 The AHRI Certified® mark indicates LG Electronics participation in the AHRI Certification program. For verification of individual certified products, go to www.ahridirectory.org.
 The ACAH***VETB / ACAH***HETB models are certified by AHRI to AHRI Standard 550/590.

Note:

1. Due to our policy of innovation some specifications may be changed without prior notification. Decode point of innovation some specification may be changed without prior inclination.
 Capacities and Inputs are based on the following conditions
 Cooling: Outdoor air temp. 35°C, Water inlet temp. 12°C, Water Outlet temp. 7°C
 The AHRI Certified® mark indicates LG Electronics participation in the AHRI Certification program. For verification of individual certified products, go to www.ahridirectory.org.
 The ACAH***VETB / ACAH***HETB models are certified by AHRI to AHRI Standard 550/590.



Inverter Scroll Chiller

Power

Capacity

Input Power

Efficiency

IPLV

Sound Pressure

Туре

No. of Compressor

Oil Type

Oil charge

Туре

Amount of Charged

Туре

Pressure drop

Operating maximum

pressure(Refrigerant / Water) Water Flow Rate(Standard)

Inlet/Outlet diameter(Water pipe)

Туре

No. of Fan

No. of Vanes(per fan)

Air Flow Rate

Motor power

W

Н

D

High/Low Pressure

Anti Frost

Expansion unit

Weight

Footprint

Remote Control

Outlet Temperature

Ambient Temperature Guaranteed Load Capacity Range

380V

Compressor

Refrigerant

Evaporator

Fan motor

Dimension

Protection Devices

Note:



ACAH067LETB

C/0

222

63.1

85.4

2.60

5.1

71

6

1,400 x 6

6.5 x 6

49.2

633

6

246 x 6 @1,000rpm

900 x 6

1,522

2,291

0.078

ACAH060LETB

195

55.4

64.6

3.02

5.3

69

6

1,400 x 6

6.5 x 6

38.8

558

6

246 x 6 @1,000rpm

900 x 6

1,522

2,291

0.089

Specification Cooling only

460V

l=	worter Scroll Chiller	Model	ACAH020HETB	ACAH023HETB	ACAH033HETB	АСАН040НЕТВ		
In	verter Scroll Chiller	Model	C/0	C/0	C/0	C/0		
	Power	Phase, Lines, V		3, 3,	460			
	C	kW	65	74	114	130		
	Capacity	RT	18.5	21.0	32.4	37.0		
	Input Power	kW	21.5	28.5	36.2	43.0		
	Efficiency	W/W	3.02	2.60	3.15	3.02		
	IPLV	W/W	5.3	5.1	5.4	5.3		
	Sound Pressure	dB(A)	64	66	66	67		
	Туре	-		Inverte	er Scroll			
c	No. of Compressor	EA	2	2	4	4		
Compressor	Oil Type	-		P	VE			
	Oil charge	СС	1,400 x 2	1,400 x 2	1,400 x 4	1,400 x 4		
D.C.	Туре	-		R4	10A			
Refrigerant	Amount of Charged	kg	6.5 x 2	6.5 x 2	6.5 x 4	6.5 x 4		
	Туре	-		Shell	& Tube			
	Pressure drop	kPa	38.8	49.2	29.6	38.8		
Evaporator	Operating maximum pressure(Refrigerant / Water)	kg/cm ²	42/10					
	Water Flow Rate(Standard)	LPM	186	211	327	372		
	Inlet/Outlet diameter(Water pipe)	mm	50A/50A	50A/50A	65A/65A	65A/65A		
	Туре	-		BL	DC			
	No. of Fan	EA	2	2	4	4		
Fan motor	No. of Vanes(per fan)	EA			6			
	Air Flow Rate	CMM	246 x 2 @1,000rpm	246 x 2 @1,000rpm	246 x 4 @1,000rpm	246 x 4 @1,000rp		
	Motor power	W	900 x 2	900 x 2	900 x 4	900 x 4		
	Expansion unit	-		El	EV			
	Weight	kg	560	560	1,034	1,034		
	W	mm	765	765	1,528	1,528		
Dimension	н	mm		2,2	200			
	D	mm		2,1	54			
	Footprint	m²/RT	0.089	0.078	0.102	0.089		
Protection	High/Low Pressure	-		(2			
Devices	Anti Frost	-	0					
	Remote Control	-		Мо	dbus			
	Outlet Temperature	°C		4~	20			
A	mbient Temperature	°C		-15	~48			
Guaran	teed Load Capacity Range	-		20 % ~	100 %			

1. Due to our policy of innovation some specifications may be changed without prior notification. 2. Capacities and Inputs are based on the following conditions

Cooling : Outdoor air temp. 35°C, Water inlet temp. 12°C, Water Outlet temp. 7°C 3. The AHRI Certified® mark indicates LG Electronics participation in the AHRI Certification program. For verification of individual certified products, go to www.ahridirectory.org. 4. The ACAH***VETB / ACAH***HETB models are certified by AHRI to AHRI Standard 550/590.

08 | 2020 Air Cooled Inverter Scroll Chiller

ACAH045LETB

148

42.1

56.9

2.60

5.1

69

4

1,400 x 4

6.5 x 4

49.2

422

4

246 x 4 @1,000rpm

900 x 4

1,034

1,528

0.078

Model

Phase, Lines, V

kW

RT

kW

W/W

W/W

dB(A)

-

EA

-

CC

-

kg

-

kPa

kg/cm²

LPM

mm

-

EA

ΕA

CMM

W

-

kg

mm

mm

mm m²/RT

-

-

-

°C

°C

-

ACAH050LETB

171

48.6

54.3

3.15

5.4

68

6

1,400 x 6

6.5 x 6

29.6

491

6

246 x 6 @1,000rpm

900 x 6

1,522

2,291

0.101

3, 4, 380-415

Inverter Scroll

PVE

R410A

Shell & Tube

42/10

65A/65A

BLDC

6

EEV

2,200

2,154

0

0

Modbus

4~20

-15~48

20 % ~ 100 %

Note:

1. Due to our policy of innovation some specifications may be changed without prior notification. Dector of provide on the following conditions
 Cooling: Outdoor air temp. 35°C, Water inlet temp. 12°C, Water Outlet temp. 7°C
 The AHRI Certified® mark indicates LG Electronics participation in the AHRI Certification program. For verification of individual certified products, go to www.ahridirectory.org.
 The ACAH***VETB / ACAH***HETB models are certified by AHRI to AHRI Standard 550/590.





Specification Heat Pump

380-415V

460V

	vortor Scroll Chiller	Model	ACAH045HETB	ACAH050HETB	ACAH060HETB	ACAH067HETB		
יחו	verter Scroll Chiller	Model	C/0	C/0	C/O	C/0		
	Power	Phase, Lines, V		3, 3,	460			
	Capacity	kW	148	171	195	222		
	Capacity	RT	42.1	48.6	55.4	63.1		
	Input Power	kW	56.9	54.3	64.6	85.4		
	Efficiency	W/W	2.60	3.15	3.02	2.60		
	IPLV	W/W	5.1	5.4	5.3	5.1		
	Sound Pressure	dB(A)	69	68	69	71		
	Туре	-		Inverte	er Scroll			
C	No. of Compressor	EA	4	6	6	6		
Compressor	Oil Type	-		P	VE			
	Oil charge	сс	1,400 x 4	1,400 x 6	1,400 x 6	1,400 x 6		
D.C	Туре	-		R41	10A			
Refrigerant	Amount of Charged	kg	6.5 x 4	6.5 x 6	6.5 x 6	6.5 x 6		
	Туре	-		Shell	& Tube			
	Pressure drop	kPa	49.2	29.6	38.8	49.2		
Evaporator	Operating maximum pressure(Refrigerant / Water)		42/10					
	Water Flow Rate(Standard)	LPM	422 491 558 63					
	Inlet/Outlet diameter(Water pipe)	mm		65A	/65A			
	Туре	-		BL	DC			
	No. of Fan	EA	4	6	6	6		
Fan motor	No. of Vanes(per fan)	EA		(5			
	Air Flow Rate	CMM	246 x 4 @1,000rpm	246 x 6 @1,000rpm	246 x 6 @1,000rpm	246 x 6 @1,000rpi		
	Motor power	W	900 x 4	900 x 6	900 x 6	900 x 6		
	Expansion unit	-		EI	EV			
	Weight	kg	1,034	1,522	1,522	1,522		
	W	mm	1,528	2,291	2,291	2,291		
Dimension	Н	mm		2,2	200			
	D	mm		2,1	54			
	Footprint	m²/RT	0.078	0.101	0.089	0.078		
Protection	High/Low Pressure	-		(0			
Devices	Anti Frost	-	0					
	Remote Control	-		Мос	lbus			
	Outlet Temperature	°C		4~	20			
Δ	Imbient Temperature	°C		-15	~48			
Guaran	teed Load Capacity Range	-		20 % ~	100 %			

			ACHH020LETB	ACHH023LETB	ACHH033LETB	ACHH040LETB	ACHH045LETB	
In	verter Scroll Chiller	Model	1 Unit			2 Unit		
	Power	Ph, Lines, V			3, 4, 380-415			
		kW	65	74	114	130	148	
C ::	Cooling	RT	18.5	21.0	32.4	37.0	42.1	
Capacity	Usefue	kW	70	80	120	140	160	
	Heating	RT	19.9	22.7	34.1	39.8	45.5	
	Cooling	kW	21.50	28.50	36.2	43.0	56.9	
Input Power	Heating	kW	23.00	28.10	38.1	45.9	56.1	
F(C.:	Cooling	W/W	3.02	2.60	3.15	3.02	2.60	
Efficiency	Heating	W/W	3.05	2.85	3.15	3.05	2.85	
	IPLV	W/W	5.3	5.1	5.4	5.3	5.1	
	Sound Pressure	dB(A)	63	65	65	66	68	
	Туре	-			Scroll			
6	No. of Compressor	EA	2	2	4	4	4	
Compressor	Oil Type	-			PVE			
	Oil charge	СС	1,40	0 x 2	1,400 x 4			
Deficient	Туре	-			R410A			
Refrigrant	Amount of Charged	kg	6.7	X 2	6.7 X 4			
	Туре	-			Shell & Tube			
F	Operating maximum pressure	kg/cm ²			42/10			
Evaporator	Standard Flow(Cooling/Heating)	LPM	186 / 200	211/229	327 / 345	372 / 400	422 / 458	
	Inlet/Outlet diameter(Water pipe)	mm	50A	/ 50A		65A / 65A		
	Expansion unit	-			EEV			
	Weight	kg	58	30		1,080		
	W	mm	76	55		1,528		
Dimension	Н	mm			2,293			
	D	mm	2,154					
	Remote Control	-	Modbus					
Outlet	Cooling	°C			4~20			
Temperature	Heating	°C			30~55			
Ambient	Cooling	°C			-15~48			
Temperature	Heating	°C			-30~35			
E	arth Leakage Breaker	А	60	60	100	100	125	

Note:

- 1. Due to our policy of innovation some specifications may be changed without prior notification.

Capacities and Inputs of inflowation some specification may be changed without profindentiation.
 Capacities and Inputs are based on the following conditions
 Cooling: Outdoor air temp. 35°C, Water inlet temp. 12°C, Water Outlet temp. 7°C
 The AHRI Certified® mark indicates LG Electronics participation in the AHRI Certification program. For verification of individual certified products, go to www.ahridirectory.org.
 The ACAH***VETB / ACAH***HETB models are certified by AHRI to AHRI Standard 550/590.

Note:

1. Due to our policy of innovation some specifications may be changed without prior notification.



Electric characteristics



Outline dimension

ACAH Series 1 Unit

Cooling only

ACA11	ι	Unit		Supply	СОМР		OFM	
ACAH	Voltage	Voltage range	МСА	MFA	MSC	RLA	kW	FLA
020VETB	208 - 230	Min.: 187, Max.: 253	72.9	100	20.4	57.5	1.8	8
033VETB	208 - 230	Min.: 187, Max.: 253	117.4	125	40.8	95.2	3.6	16
040VETB	208 - 230	Min.: 187, Max.: 253	138.4	150	40.8	115.0	3.6	16
050VETB	208 - 230	Min.: 187, Max.: 253	117.4+61.8	125+80	40.7+20.4	95.2+47.6	3.6+1.8	16+8
060VETB	208 - 230	Min.: 187, Max.: 253	138.4+72.9	150+100	40.7+20.4	115.0+57.5	3.6+1.8	16+8
020LETB	380-415	Min.: 342, Max.: 456	39	60	11.8	30.2	1.8	5
023LETB	380 - 415	Min.: 342, Max.: 456	48	60	11.8	38.2	1.8	5
033LETB	380 - 415	Min.: 342, Max.: 456	72	100	23.6	55.2	3.6	10
040LETB	380 - 415	Min.: 342, Max : 456	78	100	23.6	60.4	3.6	10
045LETB	380 - 415	Min.: 342, Max.: 456	96	125	23.6	76.4	3.6	10
050LETB	380 - 415	Min.: 342, Max.: 456	108	125	35.4	82.8	5.4	15
060LETB	380 - 415	Min.: 342, Max.: 456	117	125	35.4	90.6	5.4	15
067LETB	380 - 415	Min.: 342, Max.: 456	144	200	35.4	114.6	5.4	15
020HETB	460	Min.: 414, Max.: 506	31.0	50	9.7	24.9	1.8	5
023HETB	460	Min.: 414, Max.: 506	41.2	50	9.7	31.6	1.8	5
033HETB	460	Min.: 414, Max.: 506	48.4	60	19.5	45.6	3.6	10
040HETB	460	Min.: 414, Max. : 506	59.0	80	19.5	49.9	3.6	10
045HETB	460	Min.: 414, Max.: 506	78.2	100	19.5	63.1	3.6	10
050HETB	460	Min.: 414, Max.: 506	71.4	100	29.2	68.4	5.4	15
060HETB	460	Min.: 414, Max.: 506	87.0	125	29.2	74.8	5.4	15
067HETB	460	Min.: 414, Max.: 506	115.2	150	29.2	94.7	5.4	15

Heat pump

АСНН		Unit			Power Supply		МР	OFM	
АСПП	Hz	Volt	Voltage range	MCA	MFA	MSC	RLA	kW	FLA
020LETB	60	380-415	Min.:342, Max.:456	39	60	11.8	30.3	1.8	5
023LETB	60	380-415	Min.:342, Max.:456	48	60	11.8	39.0	1.8	5
033LETB	60	380-415	Min.:342, Max.:456	72	100	23.6	56.6	3.6	10
040LETB	60	380-415	Min.:342, Max.:456	78	100	23.6	60.6	3.6	10
045LETB	60	380-415	Min.:342, Max.:456	96	125	23.6	78.0	3.6	10

MCA: Minimum Circuit Ampere, A MFA: Maximum Fuse Ampere, A RLA: Rated Load Ampere, A MSC: Maximum Start Current, A

Note:


RLA is the current required when operated in the following condition. Cooling : Outdoor air temp. 27°C DB / 19.0°C WB, Water inlet / Outlet temp. 12°C / 7°C Heating : Outdoor air temp. 7°C DB / 6.0°C WB, Water inlet / Outlet temp. 40.0°C / 45.0°C

2. Voltage range


The chiller must be operated at the voltage within the upper and lower limit supplied from the power terminal to operate normally.

Maximum voltage variance permitted between phases is 2%.
 MCA is the criteria of selecting the wiring standard.
 MFA is used when selecting circuit breaker and grounding error circuit breaker(Electricity leakage circuit breaker).
 * For Russia only, MCA of ACAH033LETB is 76.

υ _<u>____</u>____ А

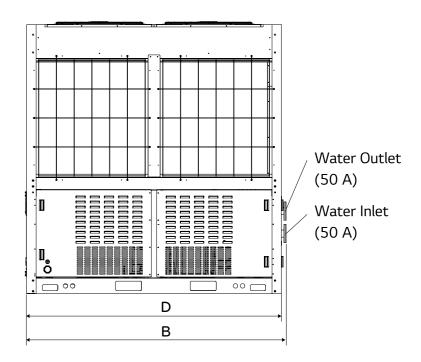

Front view

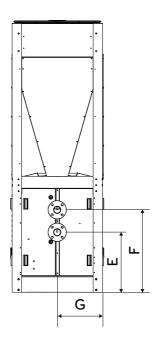



Rear view










Classification	Dimension
А	765
В	2,198
С	2,200
D	2,154
E	507
F	700
G	384

ACAH Series 2 Unit

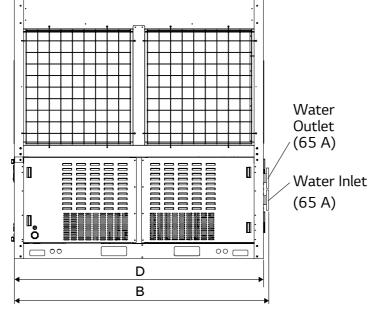

Front view

А


88888


υ

 \Box


22222

Side view

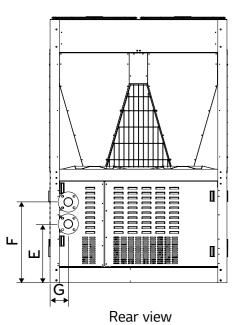





	(Unit : mm)
Classification	Dimension
А	1,528
В	2,199
С	2,200
D	2,154
E	434
F	700
G	157



.



Front view



Rear view


.G

Life's Good

Outline dimension

ACAH Series 3 Unit




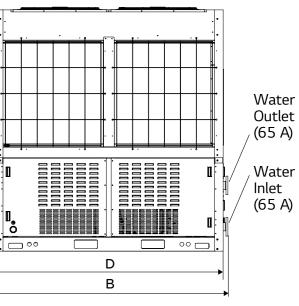

Side view

(Unit : mm)

Classification	Dimension
А	2,291
В	2,199
С	2,200
D	2,154
E	434
F	700
G	157





ACHH Series 1 Unit





Outline dimension

ACHH Series 2 Unit

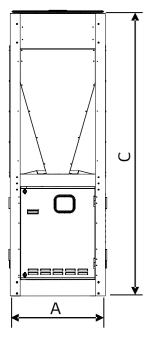

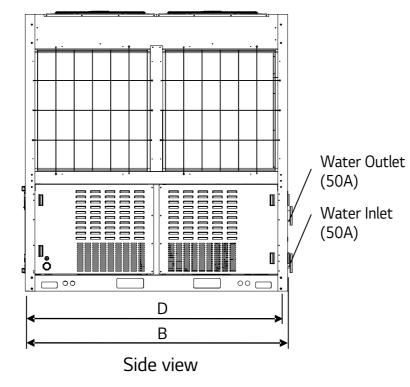

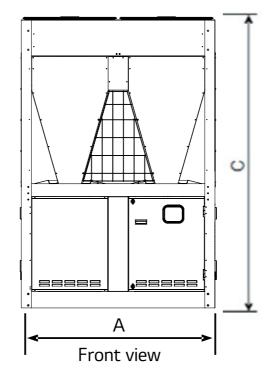

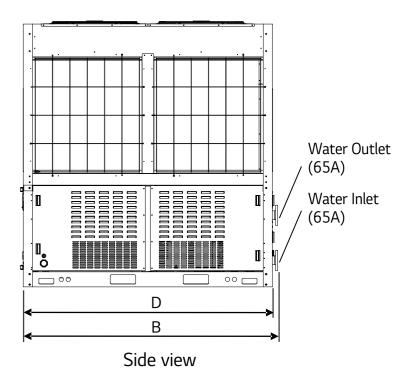


Front view













		、
(Unit	:	mm)

Classification	Dimension
А	765
В	2,198
С	2,293
D	2,154
E	507
F	700
G	384

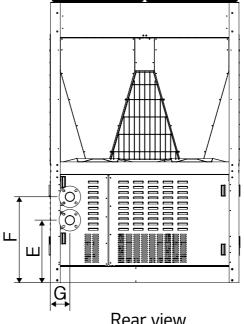



Rear view

Rear view

ш

ПII

G

1



(Unit : n	וm)
-----------	-----

Classification	Dimension
А	1,528
В	2,198
С	2,293
D	2,154
E	434
F	700
G	157




(I Init mm)

Foundation

Details to consider when installing the base

- The base must be able to withstand concentrated load.
- The base must be installed with maximum gradient of 1/300.
- The height of the base must be higher than the surface of the water and drain holes must be installed around.
- Set the height of the base according to the installation environment so that the product is not submersed in water.
- The default height of the base is 200mm and it must be at least doubled in areas with double the snowfall of 100mm or above. • Install the drain pipe in the drain hole.
- The drainage must be finished so that particles around the drainage do not clog the pipes.
- LG is not responsible for product failure or damage from incorrectly designed or manufactured base.


Shape of anchor bolt



Specification of anchor bolt


Screw size(d)	L	S	D	L1	Used drill	Depth of drill(min.)	Pullout load(N)
15.88mm(M16)	125	70	22	65	22	65	42,140

Dimension

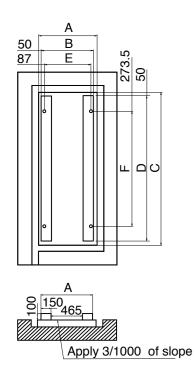



Shape of anchor bolt


		(01111, 11111)
1 Unit	2 Unit	3 Unit
865	1,630	2,391
765	1,528	2,291
2,254	2,254	2,254
2,154	2,154	2,154
691	1,456	2,217
1,707	1,707	1,707
	865 765 2,254 2,154 691	865 1,630 765 1,528 2,254 2,254 2,154 2,154 691 1,456



1 Unit Drawing of base

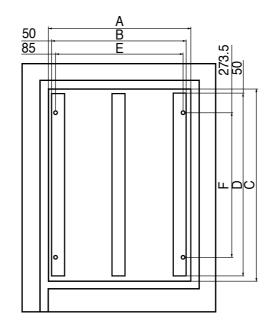








2 Unit Drawing of base



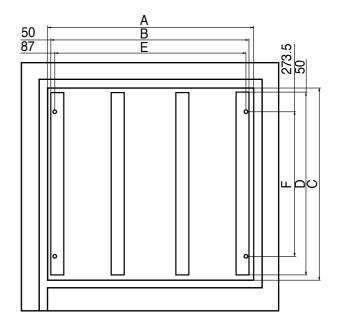



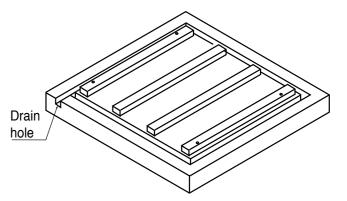


3 Unit Drawing of base







Piping diagram

ACAH Series 2 Unit

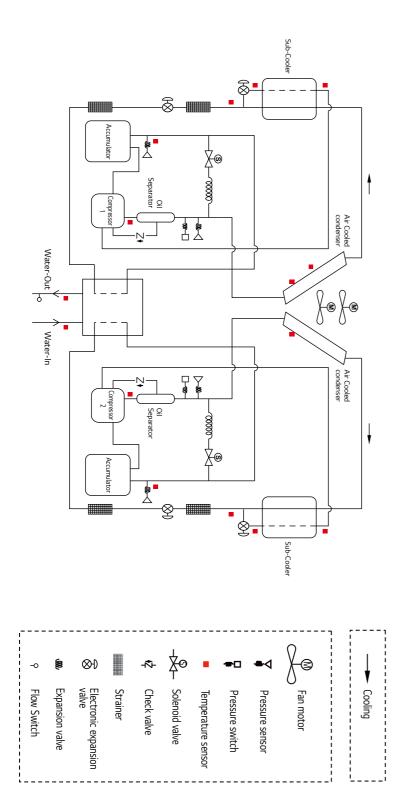

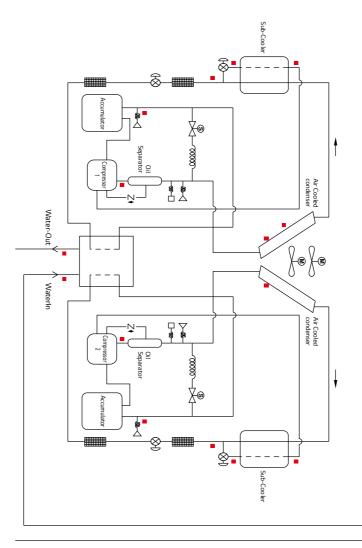




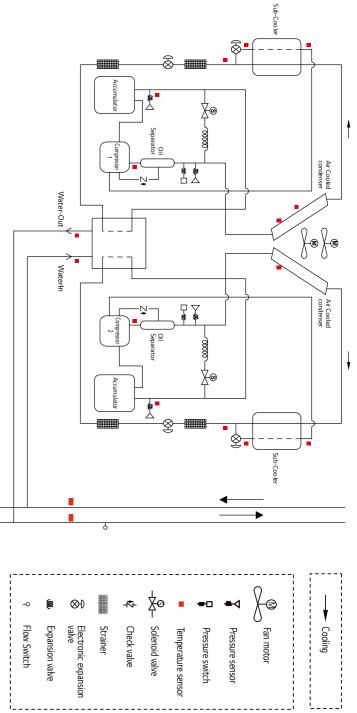

2020 LG HVAC Solution | 21

Piping diagram


ACAH Series 3 Unit

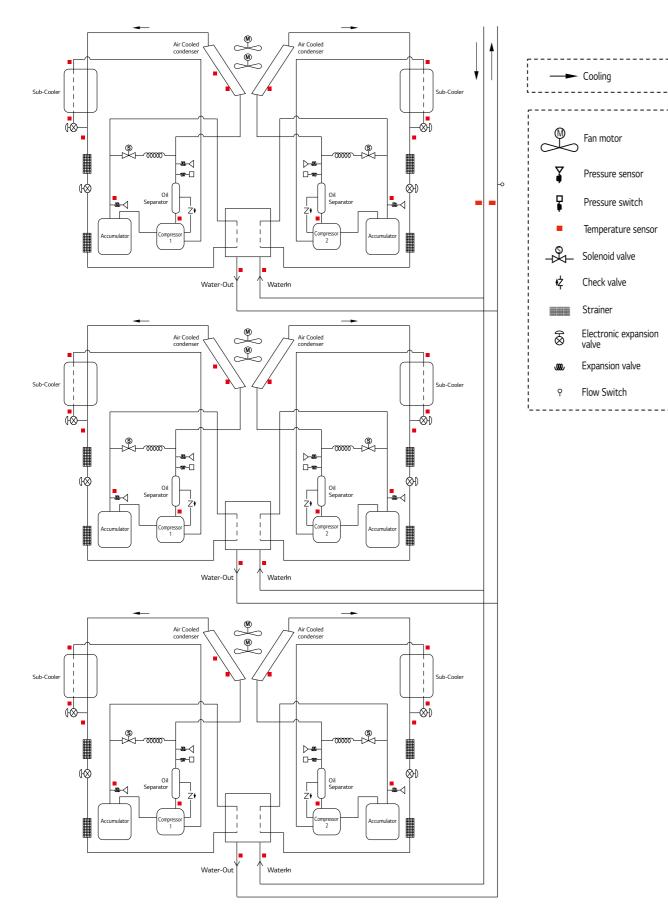

Piping diagram

ACHH Series 1 Unit

Life's Good

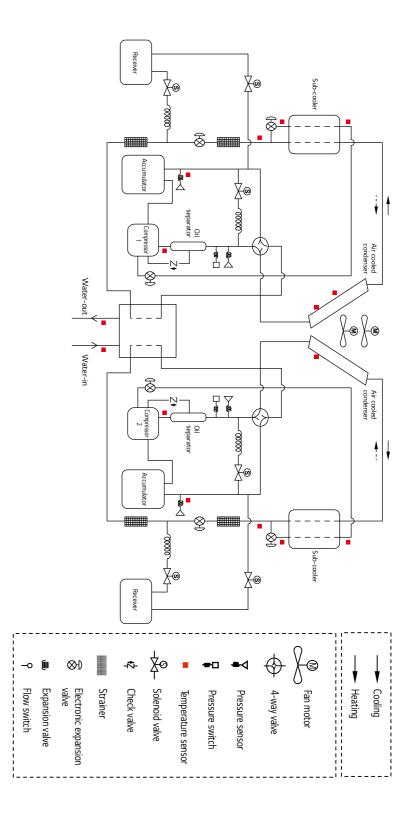



Piping diagram

ACHH Series 2 Unit


LG Life's Good

Coolir

1 Unit, 2 Unit(Main), 3 Unit(Main)

&∎ Æ \$ 6 1 2 --8 ⋛₿⋛₿ ⋛₿⋛₿ () 0 Water Wate ≧ ŢΥ Ņ ooled lenser in se \triangle ⊗ 📖 ⊗—■ ∲, §-◄ -> }-® \odot -Ň--0 Fan motor Strainer Solenoid valv Pressure sw Pressure sen 4-way valve Heating Check valve Flow :xpansion Iemperature ectronic switch

1_____

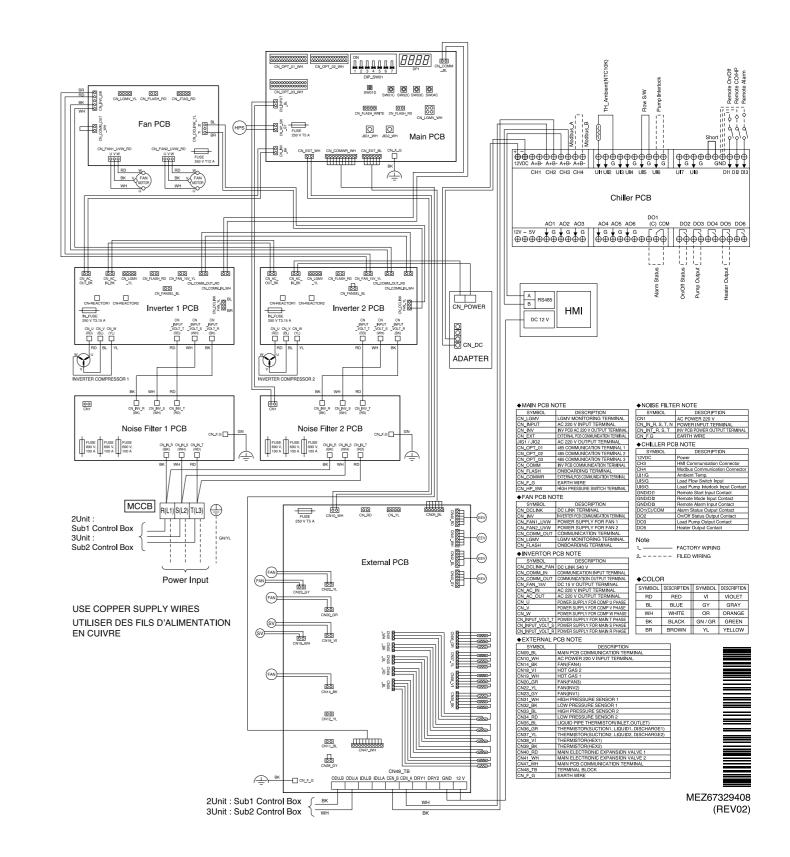





1 Unit, 2 Unit(Main), 3 Unit(Main)



1 Unit, 2 Unit(Main), 3 Unit(Main)

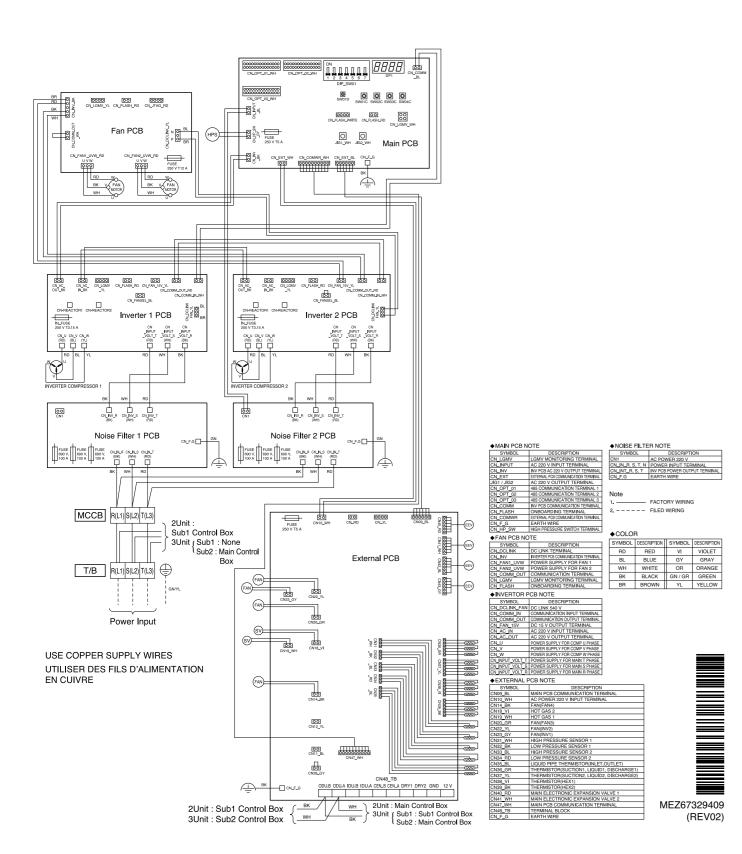

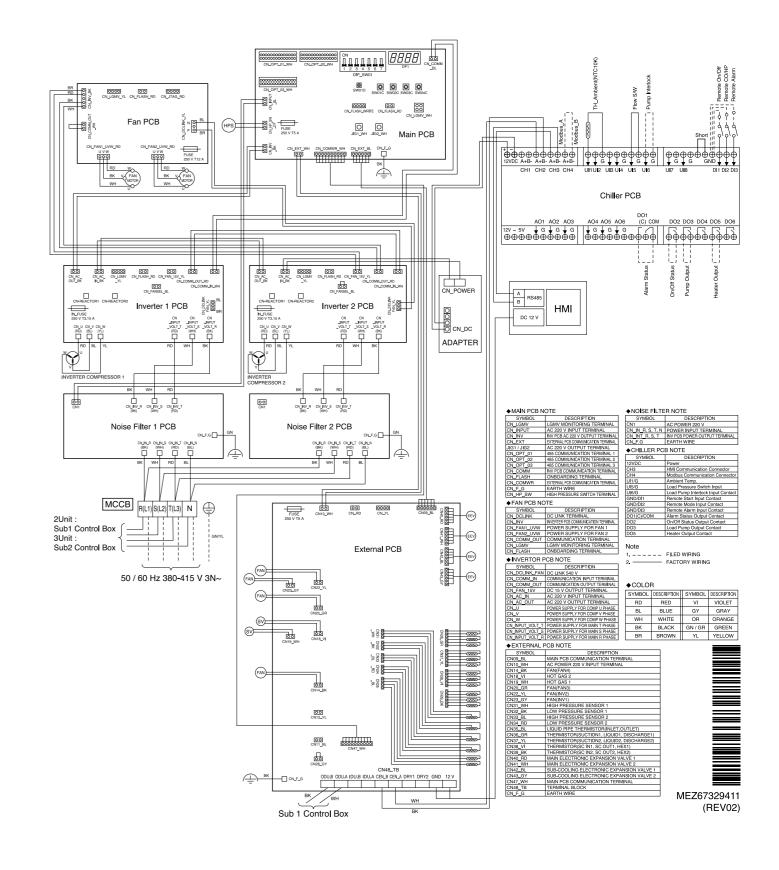







3 Unit(Sub1)

2 Unit(Sub), 3 Unit(Sub2)

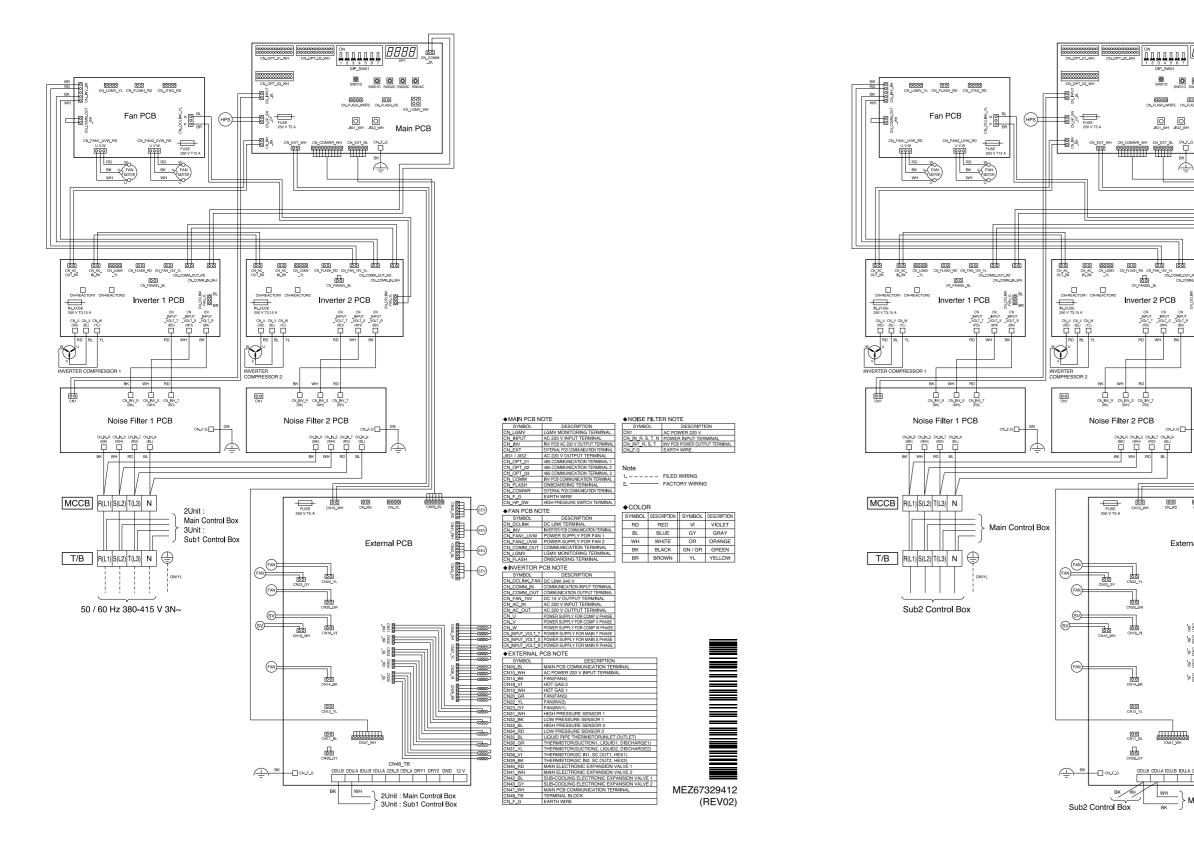




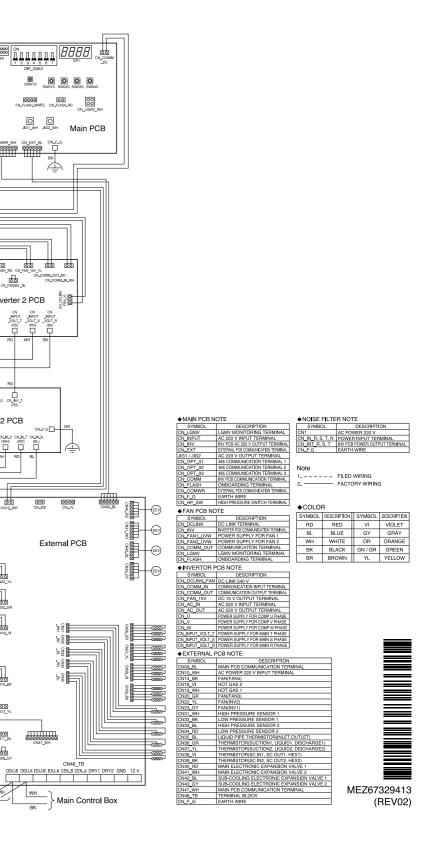




2 Unit(Sub), 3 Unit(Sub2)

1 Unit, 2 Unit(Main), 3 Unit(Main)

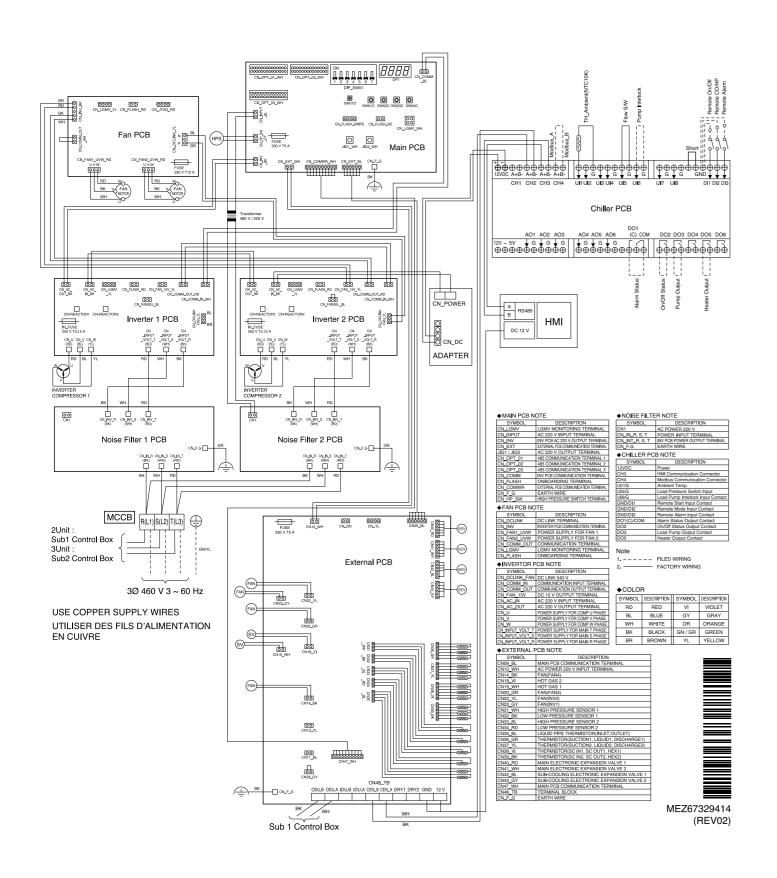

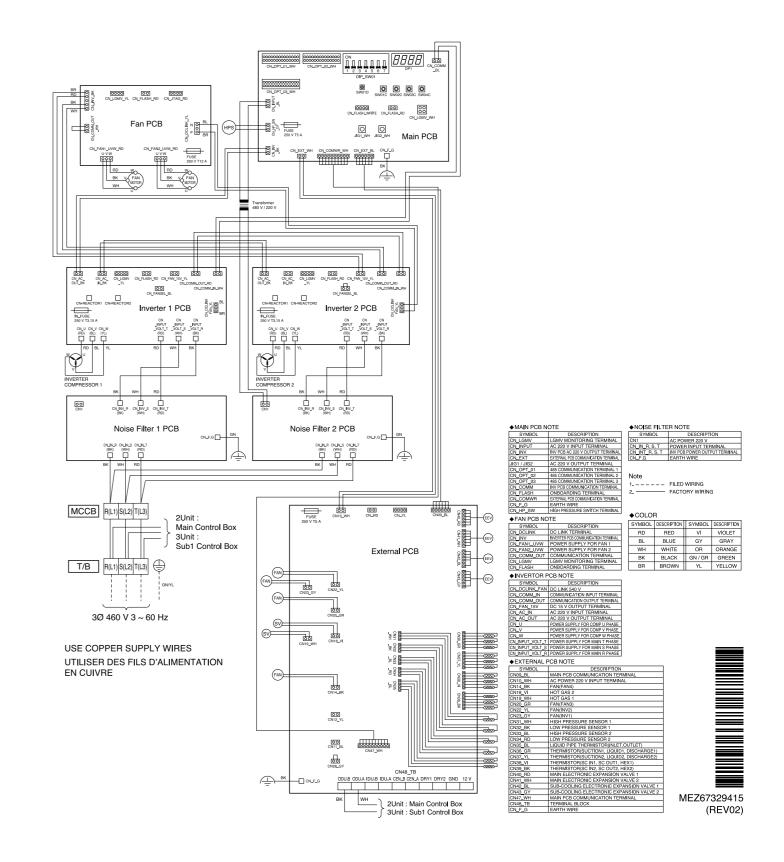




Wiring Diagrams ACAH***HETB

3 Unit(Sub1)



1 Unit, 2 Unit(Main)

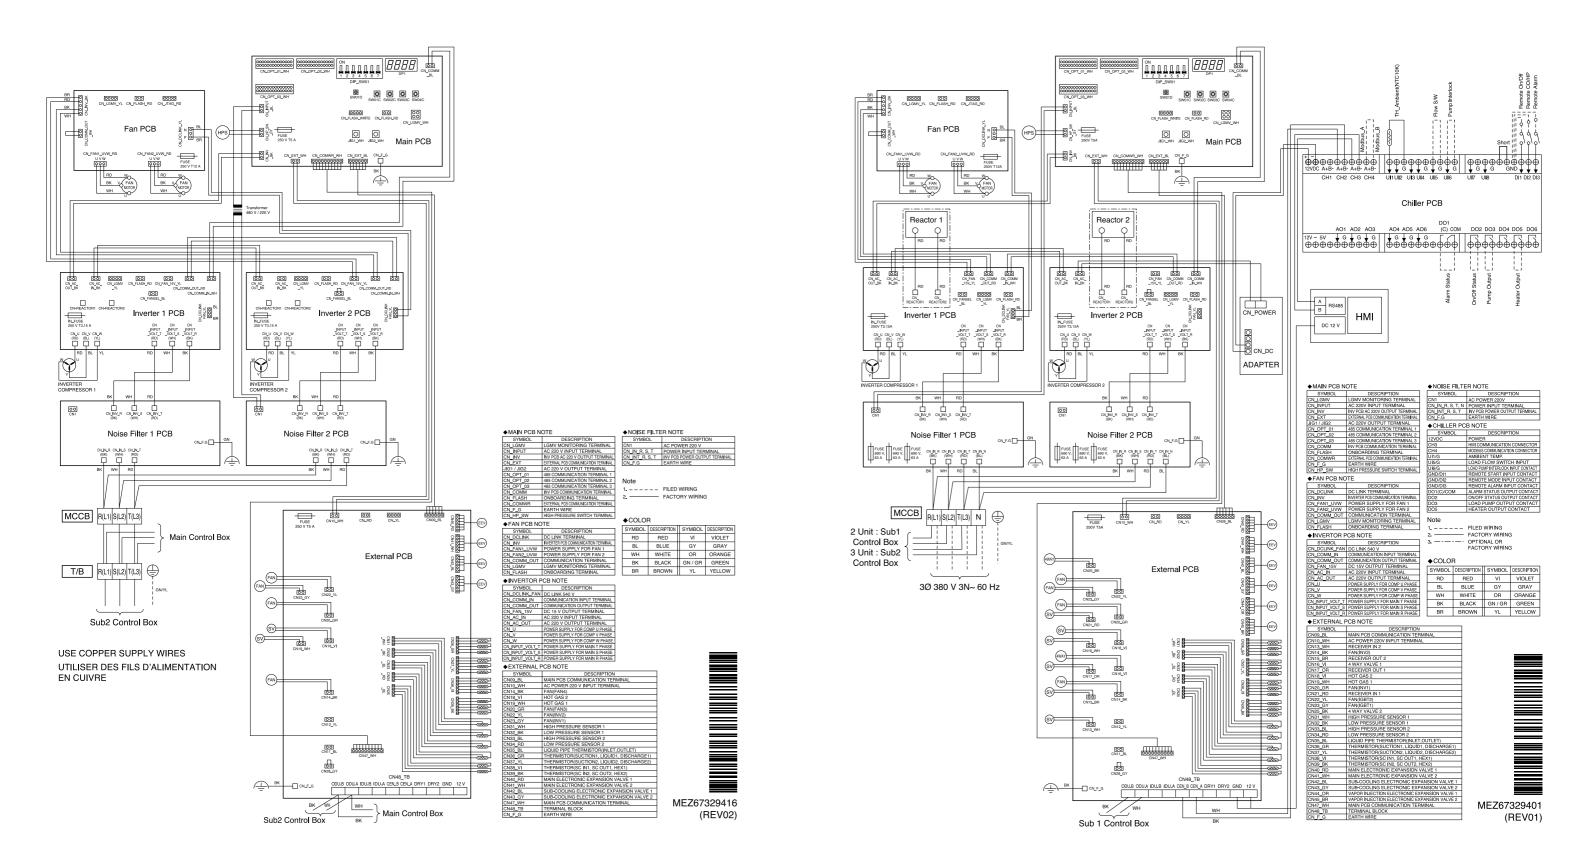






Installation of Chiller


Consider the service space

There must be sufficient space for maintenance and repair work around the chiller.

Because this is the space where the water pipes are installed, make sure to secure sufficient space for future maintenance and repair work.




Because this is the space where the water pipes are installed, make sure to secure sufficient space for future maintenance and

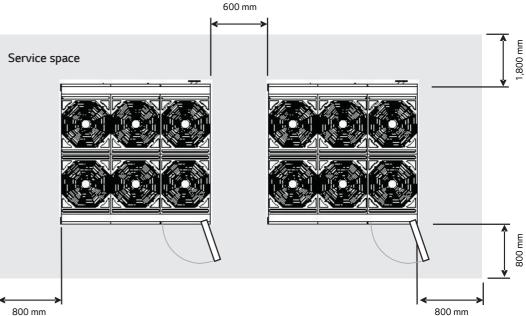

repair work.



2 Unit(Sub)

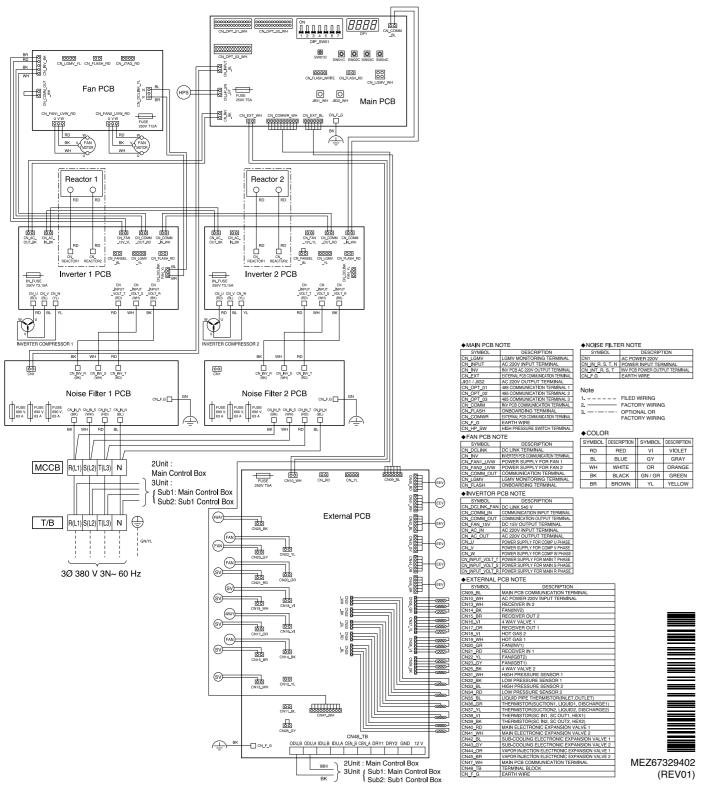





Water management


The water quality of the cold(hot) water is described as follows. The water quality must not fall below the following standard. If so, it can be judged to have risk within relatively short period of time.

ltem		Water		
	Item	Circulation type cold water	Cold water	
	PH(25°C)	6.5 - 8.0	6.5 - 8.0	
	Conduction rate(25°C µs/cm)	500 or below	200 or below	
	Alkali level(PPM)	100 or below	50 or below	
	Hardness(PPM)	100 or below	50 or below	
Chlorine i	Chlorine ion(PPM)	100 or below	50 or below	
Reference	Lactic acid ion(PPM)	100 or below	50 or below	
	Iron(PPM)	0.1 or below	0.3 or below	
	Sulfur ion(PPM)	Not detected	Not detected	
	Ammonium ion(PPM)	0.5 or below	0.2 or below	
	Silica(PPM)	50 or below	30 or below	

Water pipe connection


- Connect the pipe so that the entrance of the cold(hot) water pipe is correct.
- Permitted water pressure resistance of cold water pipe system is 1MPa
- To prevent any external heat loss or dew drops forming during the cooling operation on the water pipe system, apply thermal insulation treatment.
- Install the air vent at the output end of the water pipe.(Air vent)
- If the thermometer is installed on the inlet/outlet of the cold/hot water pipe, the operating condition of the chiller can be checked.
- Always install the strainer(50 Mesh or above) that can be cleaned on the water pipe inlet side to filter any alien particles from entering the heat exchanger.
- Always install the strainer on the leveled pipe.
- (If sand, trash or rust gets mixed to the cold water system, it can cause product failure due to corrosion of metallic parts.)
- Install the on/off valve on the cold water inlet/outlet and bypass pipe on the pipe direction of the device side.
- For the pipe system, it is recommended to install the bypass and clean the pipe before installing the product and during the annual pipe cleaning.
- On/Off valve blocks the old water to the chiller that is not operating to reduce the power of the pump. Therefore select whether to install to fit the need of the site.
- Install the pressure gauge and thermometer on the inlet and outlet of the water pipe.
- Always install the flexible joint to reduce the vibration of the pipe and product.
- Vibration of water pipe system is absorbed to prevent water leakage.
- For the cold water system part, make sure to use the component that complies with designed water pressure or above.
- Before supplying cold water to the chiller, clean inside the pipe system to remove any negative impact of particles to the product.


Detail of the piping around the pump

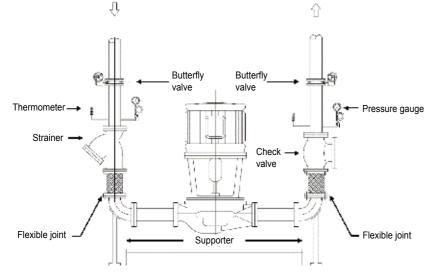

Installation mode A(Recommended method)


Independent product installation



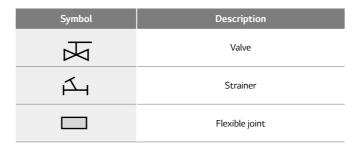



Independent product installation

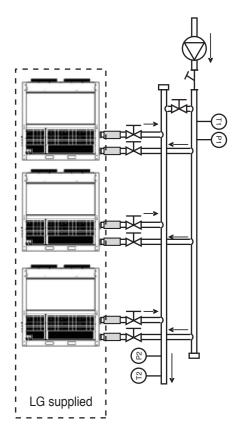


Symbol	Description
T1	Temperature sensor(1: Inlet 2: Outlet)
P1	Pressure gauge(1: Inlet, 2: Outlet)
\bigcirc	Cold water pump



Installation of Chiller

Installation mode B

Independent product installation



-T-t-LG supplied

Independent product installation

Symbol	Description
X	Valve
ГЦ	Strainer
	Flexible joint

Symbol	Description
T1	Temperature sensor(1: Inlet 2: Outlet)
P1	Pressure gauge(1: Inlet, 2: Outlet)
\bigcirc	Cold water pump

- below.
- water from freezing. - If the product does not operate for a long period of time during the winter season, remove all the circulation water to prevent the damage of heat exchanger and pipe from freezing.
- Add anti-freeze additive to prevent the circulation water from freezing during the winter season.
- Maintain the cold water flux within the designed flux to ensure appropriate chiller performance and reduce the tube management or inappropriate processing water.

Water pipe installation

CAUTION

- Appropriate pressure of pipe connection is flange connection of 1 MPa or below.
- Size of the water pipe must be the same as that of the product or larger.
- If there is risk of dew drops forming, always install the thermal insulation material on the outlet pipe of the cold water.
- To avoid connected water pipe from creeping from the load, use appropriate hook for support.
- To prevent the pipe connected part from freezing during the winter season, always install the drain valve at the most bottom of the pipe system.
- Cold water inlet pipe is located at the bottom and the outlet pipe is installed on the top.
- When connecting several chillers, refer to the following for common pipe size.

ACAH Series

Full product capacity		20 RT	40 RT	60 R	Г	80 RT		100 RT	120 RT	140 RT
Common pipe size		65 A	80 A	100 /	۹ I	100 A 1		125 A	125 A	125 A
Product	20 RT	•								
	40 RT		•			••		•		••
	60 RT							•	••	•
Full product capacity		160 RT	180 RT	200 RT	220	RT 24	IO RT	260 RT	- 280 RT	300 RT
Common	pipe size	150 A	150 A	150 A	200	A 2	A 00	200 A	200 A	200 A
Product	20 RT									
	40 RT	•		••	•			••	•	
	60 RT	••	•••	••	•••	• •	•••	•••	••••	••••

ACHH Series

Full product capacity		20 RT	40 RT	60 RT	80	RT	100 RT	120 RT	140 RT
Common pipe size		65 A	80 A	100 A	۸ I0	100 A		125 A	125 A
Product	20 RT	•		•			•		•
	40 RT		•	•	•	•	••	•••	•••
Full product capacity		160 RT	180 RT	200 RT	220 RT	240 R1	T 260 RT	280 RT	300 RT
Common	pipe size	150 A	150 A	150 A	200 A	200 A	200 A	200 A	200 A
Product	20 RT		•		•		•		•
	40 RT	••••	••••	••••	••••	•••••	• ••••	•••••	•••••

Water pump control

- If the cold water pump is not operating for a long period of time or if the anti-freeze liquid is not used as the cold water, the antifreeze pump control must be installed to prevent the pipe from freezing.
- pump, install flexible joints at the inlet/outlet and use the anti-vibration amount for the pump support.



• If the winter outdoor temperature is 0°C or below, take following measures to prevent the pipe from freezing as shown

- If the outdoor temperature is low, the circulation water can freeze to damage the heat exchanger of the product when the product is stopped. If there is possibility of damage from low outdoor temperature, operate the pump to prevent the


damage from rusting, scaling and corrosion. LG is not responsible for any damage of chiller from poor water quality

• The vibration of the pump can transfer to the pipe to cause noise indoors. As the plan to prevent the noise from spreading in the



Guide Specification(ACAH Series)

Unit Combination

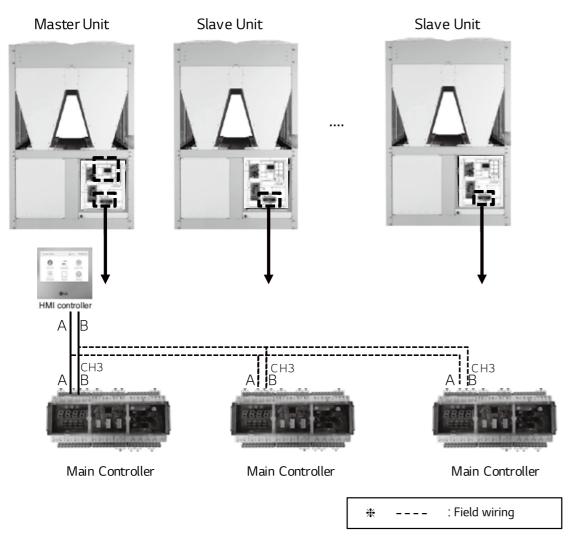

- 1) Communication line is divided A into B like a picture and is jump connected to Main Unit and Main Controller CH3 of Slave unit.
- 2) Communication line jump connected is divided A into B to HMI of Master Unit and in connected.
- 3) Use 2-line shield as a communication line
- 4) Separately install the communication and power cable of the chiller so that communication cable is not affected by the electric noise generated from power cable(Do not pass though the same electric pipe)
- 5) Unit combination is able to connect up to 5 units.



If number and address of product to want to interlock is not set from HMI, Error will occur.(please refer to control>freezer interlocking control about HMI address setting)

If Main Controller address doesn't match HMI address, Error will occur. .(please refer to control>freezer address setting about Controller address setting)



- 1. Casing
- 2. Compressor
- 3. Condenser
- 4. Electronic expansion valve
- 5. Evaporator
- 6. Control equipment
- 7. Ref. piping
- 8. Safety devices







Manufacturing specification

- 1) Use parts and materials of KS standard or equivalent for chillers not specified in this specification, and all parts should be designed with structure that is easy for replacement, repair, and inspection.
- 2) If there is a problem in the chiller, or if there is an abnormal status of chilled water temperature and flow amount, etc., immediately stop the chiller operation and you have to be equipped with certified equipment or function that can easily be identified.
- 3) There should be a protection circuit to prevent chiller damage from blackout or frequent voltage variation from power plant.
- 4) Chiller should be able to operate silently without abnormal noise or abnormal vibration.
- 5) Chiller should be composed of the central controller and the circuit possible for wired/wireless Start/Stop operation.
- 6) Easy combination should be possible with compact and module type design.
- 7) It should be the structure possible for back-up operation even if compressor or some parts fail and cooling operation should be available during parts replacement, repair, or inspection.
- 8) The main power cable with equivalent or above the specification presented in the product specification of each corresponding model should be used for the chiller, each communication line and power cable should use cable pipe for protection, and the cable pipe with the material that can block external electrical noise according to the installation environment should be used.

Air cooled type scroll chiller product specification

1. Casing

- 1) It should have the structure that is easy for disassembly and assembly for easy maintenance/repair.
- 2) It should have a good looking exterior and it should be insulated to prevent condensation.
- 3) It should have the structure preventing vibration and abnormal noise.
- 4) It should have the structure that can be grounded.

2. Compressor

- R410A refrigerant shall be used in compressor whose casing shall be completely sealed hermetic type. Combination of two inverter scroll compressors shall be provided which shall be adjusted for soft loading, and shall be a high efficiency compressing system that can optimize energy consumption by using inverter control.
- 2) Vibration prevention rubber should be used to prevent transferring noise and vibration during operation.
- 3) The frequency variable boundary of inverter scroll compressor

shall be minimum 30Hz and maximum 127Hz.

4) Alternating operation should be possible to have the uniform average operation time for each compressor.

3. Condenser

- 1) Condenser heat exchanger shall be used with purity 99.9 % or above Phosphorus Deoxidized Copper without joint, and it shall have the structure with Al fin attached to increase the heating area.(Cross fin & Tube type)
- 2) Use wide louver fin for Al fin, and pipe extension shall be carried out for efficient heat transfer.
- 3) Condenser air cooled type heat exchanger arrangement shall be 3 rows, 48 levels of 14FPI.
- 4) Pressure test for high pressure part in refrigerant side should be carried out at 4.18 MPa or above(designed pressure 3.8 MPa), and there should not be problems such as leakage or deformation.
- 5) Condensing coil that passed pressure test should be vacuumed to completely remove moisture inside.
- 6) Use propeller type Fans, which should be able to provide sufficient air flow required for cooling. Also, it should have sufficient strength for rotating speed, and should be operated silently through balance test.
- 7) Motor should be BLDC type that can increase efficiency.8) Fan shall be connected directly to driving motor.

4. Electronic Expansion Valve

- It is used at adiabatic-expansion process in refrigeration cycle and expands high pressure fluid refrigerant at condenser exit converting to low temperature / low pressure state, and linear electronic expansion valve shall be activated to adjust refrigerant amount according to evaporator load during cooling operation.
- 2) Based on data from various sensors installed in the chiller, micro-computer shall be able to analyze operation status of the system and compressor shall control the optimum refrigerant amount linearly.
- By applying electric pulse signal to stepping motor, it shall be able to play a role of adjusting refrigerant flow amount.

5. Evaporator

- 1) Evaporator shall be shell & tube type heat exchanger, and the material shall be carbon steel for shell and copper for tubes.
- 2) There should be no water leakage, and the durability should be guaranteed.
- 3) It should have the structure that can connect to chilled water pipe.
- 4) Heat exchanger should be robust structure not allowing that the refrigerant and coolant are not mixed.
- 5) It shall be a DX type heat exchanger that refrigerant flows inside tubes and water flows inside shell. Chemical cleaning should be conducted periodically for protective

maintenance of chillers.

6) As a standard, the evaporator shell is insulated with NBR (Nitrile-Butadiene Rubber) of 3/4"(19mm) thickness and black color.

6. Control equipment

- Controller operates overall system in optimal condition with a micro-computer unit installed in the chiller, and based on the 4 measured values such as suction gas pressure, discharge gas pressure, discharge gas temperature, and heat exchanger refrigerant temperature, it shall be able to control electronic expansion valve and compressor(inverter driven), etc.
- 2) There should be a function that can check all sensors connected to the chiller and various operation status.
- 3) It should be equipped with self-protection devices and system protection function.
- 4) Module type control interface shall be applied so that simple product control is possible in series installation, and relocation and re-installation of HMI controller shall be possible without shifting other control devices.

7. Refrigerant Piping

- 1) Refrigerant pipe shall be made of purity 99.9% or above Phosphorus Deoxidized Copper without joint, and it should be connected for fluent refrigerant flow between each component.
- 2) Check valve at compressor discharge side to prevent reverse flow of the discharged refrigerant shall be installed.
- 3) Strainer in the pipe to prevent solid bodies or particles from mixing in a liquid stream shall be installed.
- 4) The pipe from expansion valve to evaporator should be insulated to prevent moisture condensation on the surface of the pipe and to prevent flash gas generation from refrigerant fluid at the same time.

8. Safety devices

- Refrigerant pressure(Normal refrigerant pressure)
 A. High pressure switch
- B. High voltage protection(Sensor)

2) Temperature

- A. compressor discharge temperature superheating detection(Sensor)
- B. IPM temperature detection(Sensor)
- C. Chiller and burst protection(Sensor)
- D. Power Module application(Sensor)
- Chilled water flow
- A. Chilled water flow switch
- 4) Voltage and current(control logic)
- A. Revere phase detection and protection (Voltage monitoring system)
- B. Compressor over-current protection
- C. Fan motor over-current protection



Guide Specification(ACHH Series)

Contents

- 1. Casing
- 2. Compressor
- 3. Condenser
- 4. Electronic expansion valve
- 5. Evaporator
- 6. Control equipment
- 7. Ref. piping
- 8. Safety devices



Guide specification

Manufacturing specification

- 1) Use parts and materials of KS standard or equivalent for chillers not specified in this specification, and all parts should be designed with structure that is easy for replacement, repair, and inspection.
- 2) If there is a problem in the chiller, or if there is an abnormal status of chilled water temperature and flow amount, etc., immediately stop the chiller operation and you have to be equipped with certified equipment or function that can easily be identified.
- There should be a protection circuit to prevent chiller damage by blackout or frequent voltage variation from power plant.
- 4) Heat pump should be able to operate silently without abnormal noise or abnormal vibration.
- 5) Heat pump should be composed of the central controller and the circuit possible for wired/wireless Start/Stop operation.
- 6) Easy combination should be possible with compact and module type design.
- 7) It should be the structure possible for back-up operation even if compressor or some parts fail and cooling operation should be available during parts replacement, repair, or inspection.
- 8) The main power cable with equivalent or above the specification presented in the product specification of each corresponding model should be used for the chiller, each communication line and power cable should use cable pipe for protection, and the cable pipe with the material that can block external electrical noise according to the installation environment should be used.

Air cooled type scroll heat pump product specification

- 1. Casing
- 1) It should have the structure that is easy for disassembly and assembly for easy maintenance/repair.
- 2) It should have a good looking exterior and it should be insulated to prevent condensation.
- 3) It should have the structure preventing vibration and abnormal noise.
- 4) It should have the structure that can be grounded.

2. Compressor

- R410A refrigerant shall be used in compressor whose casing shall be completely sealed hermetic type. Combination of two inverter scroll compressors shall be provided which shall be adjusted for soft loading, and shall be a high efficiency compressing system that can optimize energy consumption by using inverter control.
- 2) Vibration prevention rubber should be used to prevent transferring noise and vibration during operation.





- 3) The frequency variable boundary of inverter scroll compressor shall be minimum 30Hz and maximum 127Hz.
- 4) Alternating operation should be possible to have the uniform average operation time for each compressor.
- 5) If multi-compressor is installed at the product, machine should keep operating when any compressor is in malfunction or trouble. Compressor can be replaced after stopping operation of machine. At this time, abnormal condition of the compressor should be confirmed by user through system controller.
- 3. Air Side Heat Exchanger(Condenser)
- 1) Condenser heat exchanger shall be used with purity 99.9 % or above Phosphorus Deoxidized Copper without joint, and it shall have the structure with Al fin attached to increase the heating area.(Cross fin & Tube type)
- 2) Use wide louver fin for Al fin, and pipe extension shall be carried out for efficient heat transfer.
- 3) Condenser air cooled type heat exchanger arrangement shall be 3 rows, 48 levels of 14FPI.
- 4) Pressure test for high pressure part in refrigerant side should be carried out at 4.18 MPa or above(designed pressure 3.8 MPa), and there should not be problems such as leakage or deformation.
- 5) Condensing coil that passed pressure test should be vacuumed to completely remove moisture inside.
- 6) Use propeller type Fans, which should be able to provide sufficient air flow required for cooling and heating. Also, it should have sufficient strength for rotating speed, and should be operated silently through balance test.
- 7) Motor should be BLDC type that can increase efficiency.
- 8) Fan shall be connected directly to driving motor.
- 4. Electronic Expansion Valve
- It is used at adiabatic-expansion process in refrigeration cycle and expands high pressure fluid refrigerant at condenser exit converting to low temperature / low pressure state, and linear electronic expansion valve shall be activated to adjust refrigerant amount according to evaporator load during cooling operation.
- 2) Based on data from various sensors installed in the chiller, micro-computer shall be able to analyze operation status of the system and compressor shall control the optimum refrigerant amount linearly.
- 3) By applying electric pulse signal to stepping motor, it shall be able to play a role of adjusting refrigerant flow amount.
- 5. Water Side Heat Exchanger(Evaporator)
- 1) Evaporator shall be shell & tube type heat exchanger, and the material shall be carbon steel for shell and copper for tubes.
- 2) There should be no water leakage, and the durability should be guaranteed.

Guide specification



Memo

- 3) It should have the structure that can connect to chilled and heating water pipe.
- 4) Heat exchanger should be robust structure not allowing that the refrigerant and coolant are not mixed.
- 5) It shall be a DX type heat exchanger that refrigerant flows inside tubes and water flows inside shell. Chemical cleaning should be conducted periodically for protective maintenance of chillers.
- 6) As a standard, the evaporator shell is insulated with NBR (Nitrile-Butadiene Rubber) of 3/4"(19mm) thickness and black color.
- 6. Control equipment
- Controller operates overall system in optimal condition with a micro-computer unit installed in the chiller, and based on the 4 measured values such as suction gas pressure, discharge gas pressure, discharge gas temperature, and heat exchanger refrigerant temperature, it shall be able to control electronic expansion valve and compressor(inverter driven), etc.
- 2) There should be a function that can check all sensors connected to the chiller and various operation status.
- 3) It should be equipped with self-protection devices and system protection function.
- 4) Module type control interface shall be applied so that simple product control is possible in series installation, and relocation and re-installation of HMI controller shall be possible without shifting other control devices.
- 5) The operating status of the pump connected directly to the product should be monitored by the controller.
- 6) The controller of the product can be installed at a distance of less than or equal to 500M distance to control room without any additional control device so that it can be remotely controlled in the control room.
- 7) It should have a function to record operation data, and the lastest 180 seconds of data should be retained even if there is no extra storage device.
- Scheduled operation shall be possible after setting a weekly operation pattern.
- 9) The controller shall be equipped with a cycle indication display to directly monitor refrigerant pressure conditions for refrigeration cycle and high pressure gas safety management.
- 7. Refrigerant Piping
- Refrigerant pipe shall be made of purity 99.9% or above Phosphorus Deoxidized Copper without joint, and it should be connected for fluent refrigerant flow between each component.
- 2) Check valve at compressor discharge side to prevent reverse flow of the discharged refrigerant shall be installed.
- 3) Strainer in the pipe to prevent solid bodies or particles from mixing in a liquid stream shall be installed.
- 4) The pipe from expansion valve to evaporator should be insulated to prevent moisture condensation on the surface

of the pipe and to prevent flash gas generation from refrigerant fluid at the same time.

- 5) Bypass connection with electric automation valve to flow hot gas refrigerant to the suction pipe when discharged gas temperature is above the rated temperature should be installed to protect compressor and chiller.
- 6) After completing the piping, carry out pressure test on refrigerant side at 4.18 MPa or above(design pressure 3.8 MPa), and there should be no leakage or deformation.
- 7) After carrying out pressure test, completely vacuum inside so that there is absolutely no moisture.

8. Safety devices

- 1) Refrigerant pressure(Normal refrigerant pressure) A. High pressure switch
- B. High voltage protection(Sensor)
- 2) Temperature
- A. Compressor discharge temperature superheating detection(Sensor)
- B. IPM temperature detection(Sensor)
- C. Freeze and burst protection(Sensor)
- D. Power Module application(Sensor)
- 3) Chilled and heating water flow
- A. Chilled and heating water differential pressure switch
- 4) Voltage and current(control logic)
- A. Revere phase detection and protection (Voltage monitoring system)
- B. Compressor over-current protection
- C. Fan motor over-current protection

